
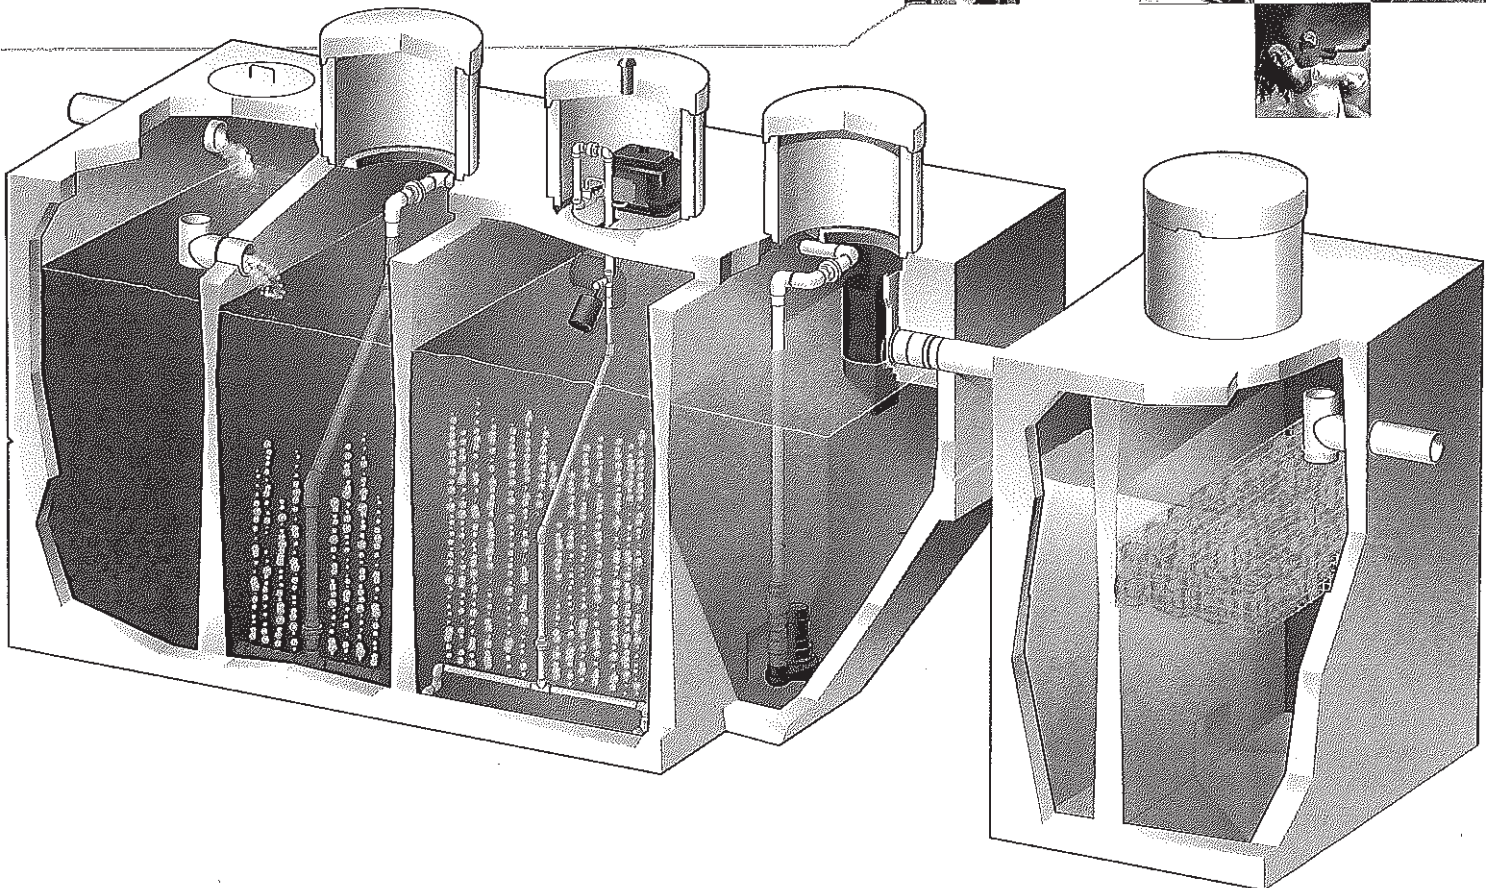
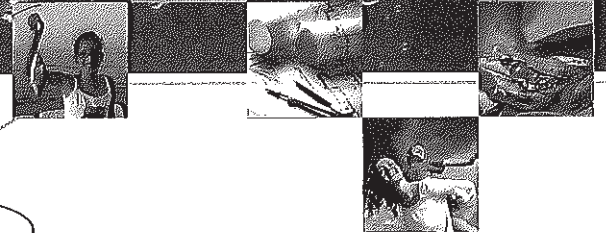


20130385


HYDRO-KINETIC® FEU

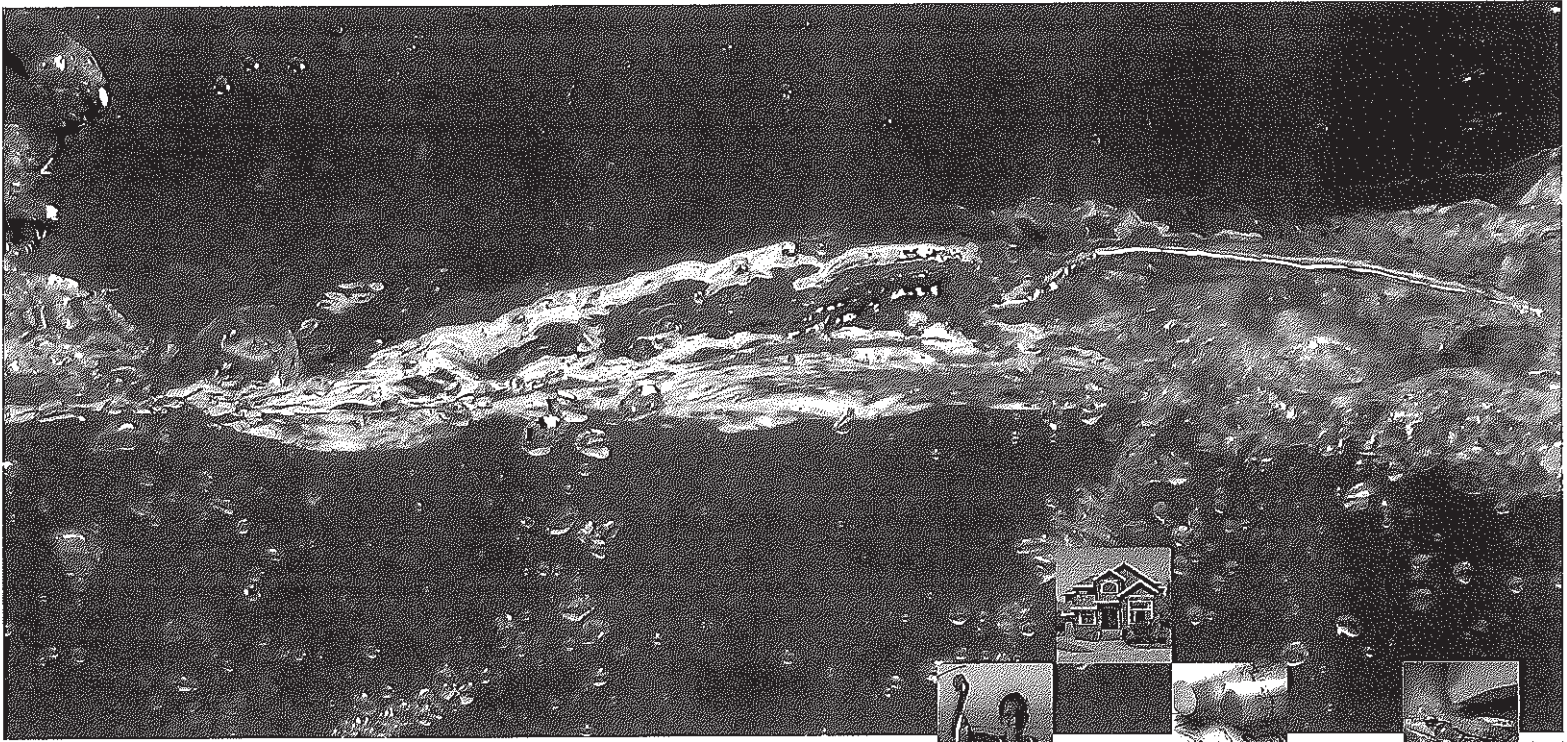

norweco®

Engineering the future of water
and wastewater treatment

Revolutionary in design, unparalleled in performance

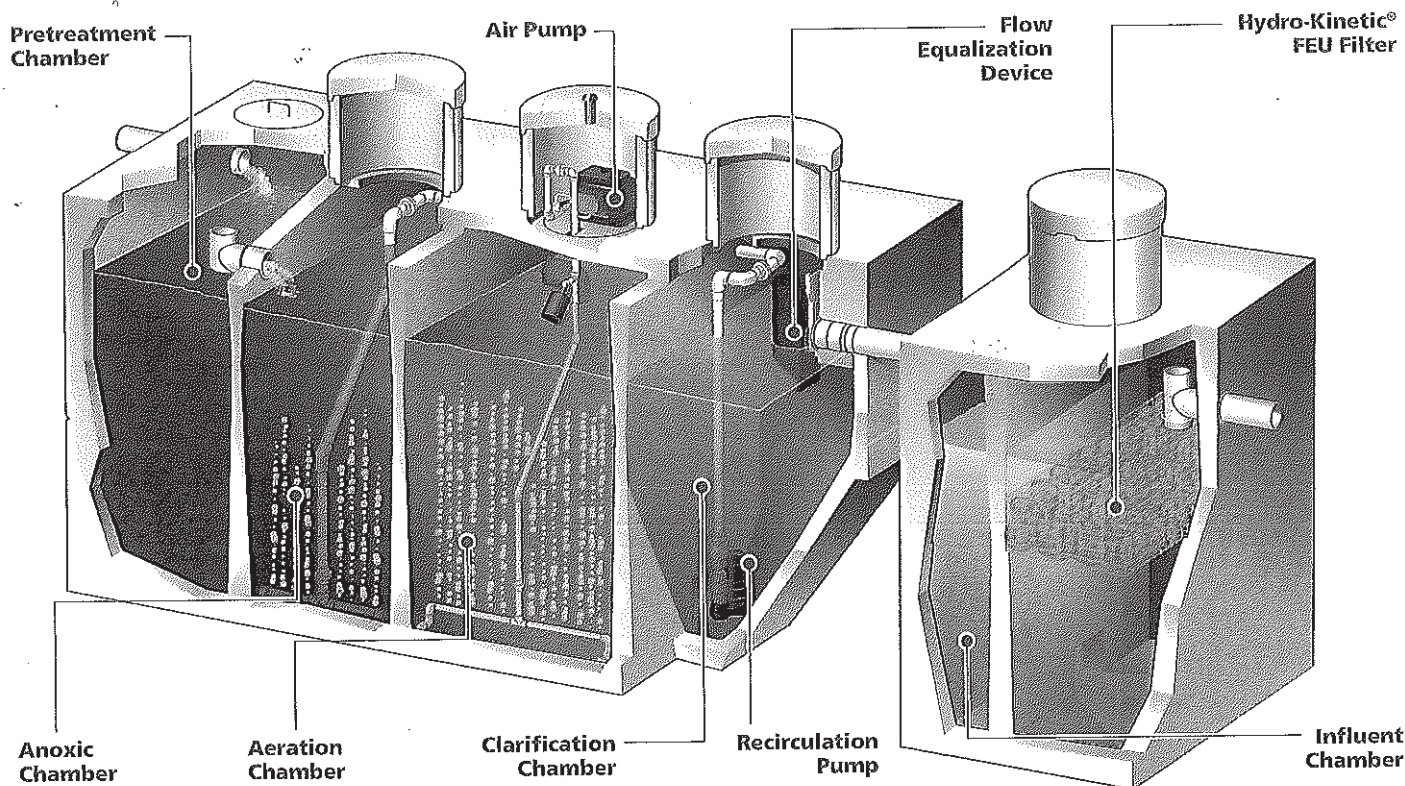

Pretreatment Chamber

Anaerobic bacteria and gravity precondition the wastewater here to protect the integrity of downstream treatment processes.

Anoxic Chamber

Pretreatment Chamber effluent is mixed with nitrified liquid recirculated from the clarifier in measured doses, via a mixing bar in this chamber. Under carefully controlled conditions, bacteria remove nitrogen by consuming nitrate-bound oxygen during their respiratory process.

Aeration Chamber

Here, safe, living aerobic bacteria convert the wastewater into stable substances. Flow equalization maximizes this biological oxidation and assures proper retention and treatment.

Model A100 Air Pump

Our exclusive Model A100 air pump is a precision engineered electro-mechanical device that has been specifically designed for use in the system. It can be installed below grade or remotely located up to 75 feet from the system.

Clarification Chamber

Flow equalization enhances the settling of biologically active substances inside the Clarification Chamber. Pretreated, aerated wastewater has now been converted to clarified liquids for discharge from this chamber.

Model SD103 Recirculation Pump

This highly efficient recirculation pump is installed at the bottom of the Clarification Chamber and is used to transfer nitrified liquid back to the Anoxic Chamber for denitrification.

Flow Equalization Device

Controls flow through the treatment process and regulates the velocity of treated effluent that can leave the system, enhancing the efficiency of the attached growth filtration media in the Hydro-Kinetic system.

Hydro-Kinetic® FEU Filter


Flow equalized liquid from the clarifier enters the Hydro-Kinetic filter where it flows downward and is evenly distributed beneath our exclusive Hydro-Kinetic filtration media. The liquid then travels through the proprietary attached growth filtration media where the final treatment takes place.

Precast Concrete Tank

Every tank is constructed of high quality, non-corrosive materials under rigid quality control standards. The tank, access risers and covers are reinforced precast concrete manufactured locally by your licensed Norweco distributor.


AT 1500 Ultraviolet Disinfection System

CAPABLE OF MEETING EVEN THE MOST STRINGENT ENVIRONMENTAL REQUIREMENTS, THE MODEL AT 1500 UV DISINFECTION SYSTEM REDUCES BACTERIA LEVELS FROM SECONDARY EFFLUENT TO MEET STRICT WATER QUALITY STANDARDS. THE AT 1500 IS THE ONLY UV TREATMENT SYSTEM LISTED BY UNDERWRITERS LABORATORIES FOR RESIDENTIAL APPLICATIONS.

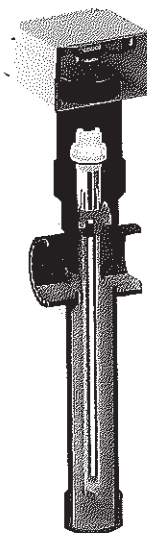


Consider the facts:

- The Hydro-Kinetic FEU system meets or exceeds regulatory standards and is performance certified and listed by NSF International to Standards 40 and 245. The system achieved an astounding effluent quality of 2.1 mg/L CBOD, 1.8 mg/L TSS and 7.95 mg/L TN.
- The system produced these unmatched effluent results while being tested for 12 continuous months without service. The Hydro-Kinetic system passed two consecutive 6 month tests with flying colors, including duplicate multi-stress sequences.
- We have engineered the Model A100 air pump to maximize operational efficiency and increase service life. It requires minimal electricity to operate and utilizes a standard 115V power connection. Multiple air pump mounting locations are available.
- The Model SD103 recirculation pump features a 1/2 horsepower electric motor that is securely mounted in an oil-filled, watertight, corrosion resistant housing with lubricated ball bearings to assure long life. The recirculation pump features a 2" discharge connection.
- The Hydro-Kinetic FEU filter provides final treatment of the wastewater to a near pristine state. As liquid flows up through our proprietary attached growth filtration media, final polishing takes place insuring only the highest quality effluent is safely returned to the environment.

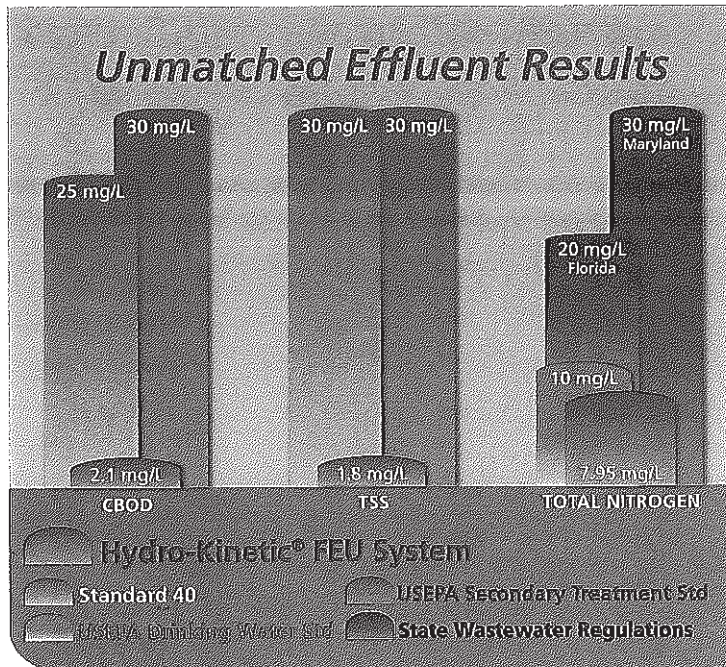


- 70-hour retention in the Hydro-Kinetic system insures adequate exposure to all treatment processes and reduces pumping frequency as compared to smaller capacity systems.
- Our patented non-mechanical flow equalization device guarantees that all incoming wastewater is fully treated, regardless of heavy use periods.
- All flow is equalized an average of 50% at the NSF Standard 40/245 600 GPD (gallons per day) design loading pattern.
- Durable, reliable components are safely installed out-of-sight below grade. No exposed power cords or air lines that are above ground.
- Your local licensed Norweco distributor sells, installs and services your Hydro-Kinetic system with pride. You'll find their name and contact info conveniently posted on the system's control center.

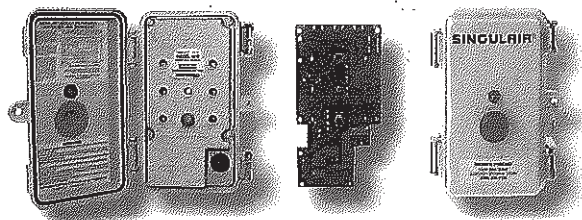

SERVICE PRO® Model 801P

EVERY SYSTEM COMES WITH THE SERVICE PRO MODEL 801P CONTROL CENTER THAT USES MCD TECHNOLOGY TO PROVIDE MONITORING, COMPLIANCE AND DIAGNOSTIC FUNCTIONS FOR THE TREATMENT SYSTEM. EACH CONTROL CENTER INCLUDES A TIME CLOCK, ALARM LIGHT, RESET BUTTON, POWER SWITCH, POWER LIGHT, PHONE/NETWORK LIGHT, RECIRCULATION PUMP ALARM, AIR PUMP ALARM, HIGH WATER ALARM AND ADDITIONAL AUXILIARY COMPONENT INPUT.

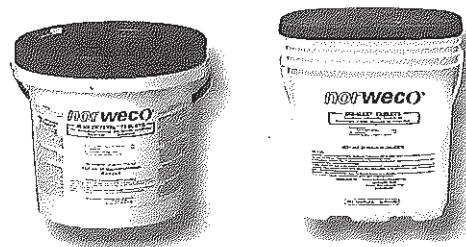

Blue Crystal® Residential Disinfecting Tablets and Bio-Max® Dechlorination Tablets

PURE CALCIUM HYPOCHLORITE TABLETS FORMULATED FOR USE IN RESIDENTIAL SYSTEMS, BLUE CRYSTAL TABLETS CONTAIN 70% AVAILABLE CHLORINE TO PROVIDE EFFICIENT, RELIABLE DISINFECTION. BIO-MAX TABLETS PROVIDE A CONVENIENT SOURCE TO INSTANTLY REMOVE CHLORINE FROM WASTEWATER, POTABLE WATER AND PROCESS WATER. EACH TABLET CONTAINS 92% SODIUM SULFITE.

***norweco*[®]**


HYDRO-KINETIC[®]

WASTEWATER TREATMENT SYSTEM

MODEL 600 FEU

GENERAL SPECIFICATIONS

The contractor shall furnish and install one complete Hydro-Kinetic wastewater treatment system with all necessary parts and equipment as described in the following specifications. Treatment of the domestic wastewater shall be accomplished by the extended aeration process with non-mechanical flow equalization, pretreatment of the influent and filtration of the final effluent. The treatment system shall provide primary, secondary and tertiary treatment of the wastewater flow, denitrification, and if required, chlorination/dechlorination or ultraviolet disinfection of the effluent prior to discharge. All treatment processes shall be contained within reinforced precast concrete tankage meeting the requirements of ACI Standard 318. The wastewater treatment system shall be a Hydro-Kinetic Model 600 FEU as manufactured by Norweco, Inc., Norwalk, Ohio, USA.

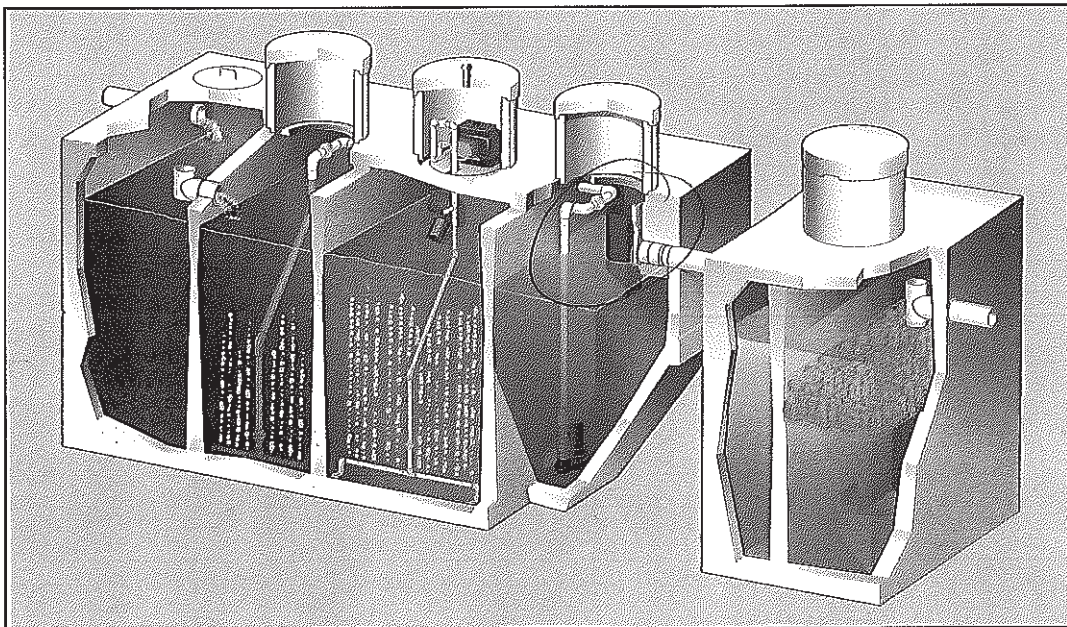

The wastewater treatment system shall include precast concrete tankage providing separate pretreatment, anoxic, aeration, clarification and final filtration chambers. The tankage shall be furnished with cast-in-place inlets, submerged transfer ports, access risers with removable covers, cast-in-place molded plastic vent assembly, cast-in-place clarification outlet coupling and cast-in-place outlet tee. Principal items of electro-mechanical equipment supplied with the Hydro-Kinetic system shall be a Model A100 air pump, Model SD103 recirculation pump, UL Listed Service Pro Model 801P electrical control center with MCD technology, flow equalization device and Hydro-Kinetic FEU filter for final filtration of system effluent.

SPECIFICATIONS

HYDRO-KINETIC[®]


OPERATING CONDITIONS

(72 hrs = 3 days)

Total holding capacity of the system shall provide a minimum of 70 hour retention of the daily flow. The pretreatment chamber shall provide at least 15 hour retention, the anoxic chamber shall provide at least 15 hour retention, the extended aeration chamber shall provide at least 21 hour retention, the clarification chamber shall provide at least 7 hour retention and the Hydro-Kinetic filter shall provide at least 12 hour retention of the daily flow. The non-mechanical flow equalization device shall increase individual chamber and total system retention time in direct proportion to loading. Design of the system shall include a compartmented tank and non-mechanical flow equalization device to insure successful treatment performance without upset even when the significant runoff period is six hours. Hydraulic design considerations of the system and flow equalization device shall be such that intermittent peak flow factors as high as four shall not upset hydraulic reliability within the system. Capability of the system to perform as outlined, when built by an approved manufacturer, shall be certified by an independent testing laboratory and approved for use by the local governing regulatory agency.

PRETREATMENT CHAMBER

All domestic wastewater shall be preconditioned while passing through the pretreatment chamber prior to being introduced to the anoxic chamber. The outlet of the pretreatment chamber shall be equipped with a discharge tee that extends vertically into the liquid so that only the preconditioned flow from the center area of the chamber is displaced to the anoxic chamber. The discharge tee and transfer port shall be of adequate size to handle a peak flow factor of four without restricting the outlet and disturbing hydraulic displacement to the anoxic chamber. A removable inspection cover shall be cast into the top of the pretreatment chamber to allow tank and transfer tee inspection. As a safety measure, the uncovered opening shall be small enough to insure that the tank cannot be entered for inspection or service.

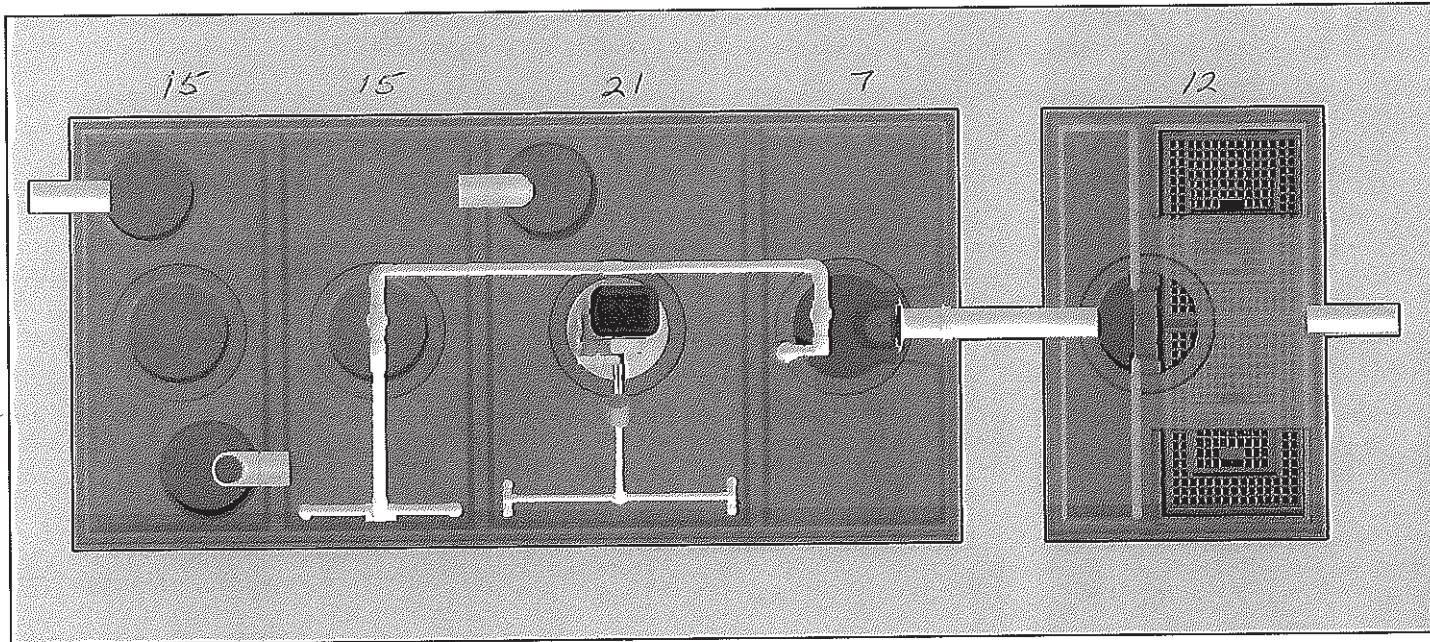


ANOXIC CHAMBER

The anoxic chamber shall provide in excess of 15 hour retention of the equalized daily flow. In the anoxic chamber, low oxygen levels shall compel facultative heterotrophic bacteria to use nitrate-bound oxygen in their respiratory process. Nitrified liquid from the clarifier shall enter the chamber in measured doses and nitrogen compounds shall be converted to harmless nitrogen gas which shall escape into the atmosphere. Overall design of the chamber shall insure that effective mixing and suspension of the biomass is maintained in an anoxic condition to insure consistent biological denitrification. Systems that have not been performance certified to reduce Total Nitrogen (TN) to less than 10 mg/L shall not be considered for this application.

SPECIFICATIONS


CERTIFIED PERFORMANCE

The wastewater treatment system shall be certified to operate for 12 consecutive months at the rated daily capacity without routine service. This performance shall be demonstrated by a continuous 12 month evaluation performed by an independent ANSI accredited, third-party testing facility. The evaluation shall consist of 2 consecutive ANSI/NSF Standard 40 and 245 evaluations back-to-back, including the stress sequences, with no maintenance allowed in between. When the first six-month evaluation is complete, the second full six-month evaluation shall immediately begin. For the entire certification protocol, the system shall achieve a total test average for the consecutive 12 month period of less than 5 mg/L Biochemical Oxygen Demand (CBOD), less than 5 mg/L Total Suspended Solids (TSS), and less than 10 mg/L Total Nitrogen (TN) in the effluent. Systems unable to meet these effluent quality parameters for at least 12 months of continuous testing by an independent ANSI accredited, third-party testing facility without service do not provide the desired level of effluent quality or service frequency, and shall not be considered for this application.

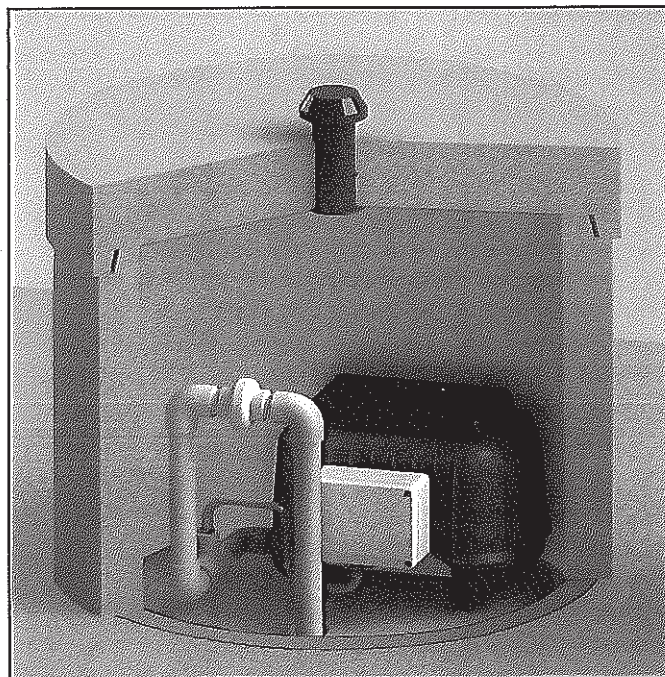

MODEL A100 AIR PUMP

The Model A100 air pump shall be configured to allow remote mounting or installation within the access riser above the aeration chamber. When installed in the access riser, fresh air shall enter through a molded plastic vent assembly or integral perimeter vent in the access cover above the air pump. Fresh air shall enter the air pump through a filter located under the housing cover and be introduced below the liquid surface through a prefabricated diffuser assembly. Only the plastic diffuser assembly and the air piping shall be installed in contact with the liquid. The Model A100 air pump shall be wired for 115 volt, single phase, 60 cycle operation. The air pump shall include impact-resistant rubber diaphragms and valves which prolong

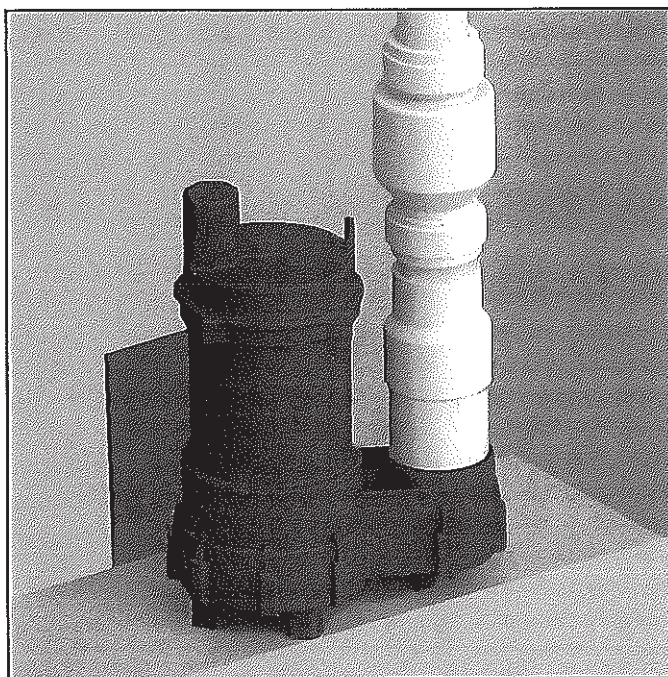

operational life. The unique design and construction shall provide easy maintenance, excellent cooling and quiet operation. The air pump shall continue aerating and mixing the aeration chamber even during high water conditions. Treatment systems that interrupt air delivery during high water conditions disrupt biological activity and shall not be considered for this application.

MODEL SD103 RECIRCULATION PUMP


The Model SD103 submersible recirculation pump shall be wired for 115 volt, single phase, 60 cycle operation and shall be installed in the clarification chamber. The pump motor shall be $\frac{1}{3}$ horsepower, operating at 3000 RPM. All openings in the flow path of the recirculation pump shall be of sufficient size to permit the passage of a $\frac{3}{4}$ " diameter sphere. The pump shall be designed to be non-overloading throughout the entire pump curve and shall draw less than 7 full load amps. The pump motor shall contain moisture resistant windings and shall be securely mounted inside an oil-filled, watertight housing for maximum pump life. The stator housing and casing shall be of high grade cast iron or thermoplastic construction.

AERATION CHAMBER

The extended aeration chamber shall provide in excess of 21 hour retention of the equalized daily flow. The chamber shall be of sufficient size to provide a minimum of 80 cubic feet of tank capacity per pound of applied BOD. The aeration chamber length-width-depth ratio shall be designed to insure uniform tank mixing and provide optimum treatment. The aeration chamber(s) shall be an integral part of the system flow path and constructed of properly reinforced 5,000 PSI, 28 day compression strength precast concrete. All castings used to construct the precast concrete tankage shall be monolithic units with external and internal walls incorporated into each section.


FINAL CLARIFICATION CHAMBER

The final clarification chamber shall consist of 5 functionally independent zones operating together to provide satisfactory settling and clarification of the equalized flow. An inlet zone shall be provided and shall dissipate transfer turbulence at the flow inlet of the clarification chamber. A recirculation pump in the settled sludge zone shall transfer a portion of the wastewater back to the anoxic chamber. Liquid is then displaced into the hopper zone of the clarifier. In this zone, settling by gravity takes place. Three of the four sidewalls are slanted to form a hopper which directs all settled material back to the settled sludge zone. Clarified liquid from the hopper zone shall be displaced into the final settling zone to provide additional clarification of the liquid. The liquid is finally displaced to the outlet zone where the treated effluent shall pass through the flow equalization device and be discharged from the final clarification chamber.

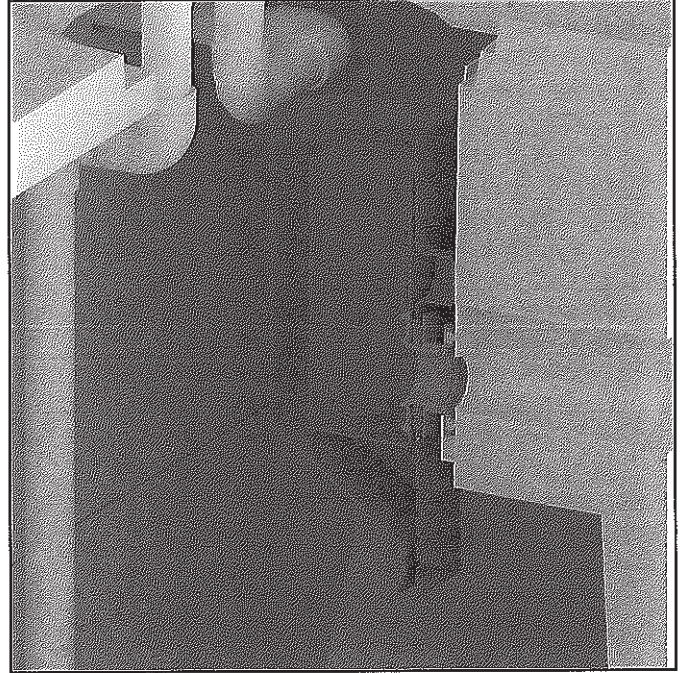

FLOW EQUALIZATION DEVICE

The system shall include a non-mechanical, demand use, flow equalization device. The device shall be installed with the design flow equalization port located below the normal liquid level of the clarifier. If intermittent flow rates exceed the capacity of the design flow port, flow shall be held upstream until the intermittent flow dissipates. If the intermittent flow continues to increase, the liquid level may reach a sustained flow equalization port. With both ports in use, flow through the system increases while continuing to provide flow equalization to upstream and downstream processes. A peak flow equalization port is supplied but should not be required in a properly sized system. The device shall control normal residential flow rates and reduce typical residential flow surges. The flow equalization rate shall be dependent upon the specific loading pattern and the duration of flow surges. At the 600 GPD (gallons per day) NSF Standard 40/245 design loading schedule, minimum performance of the device shall equalize daily flow an average of 50%.

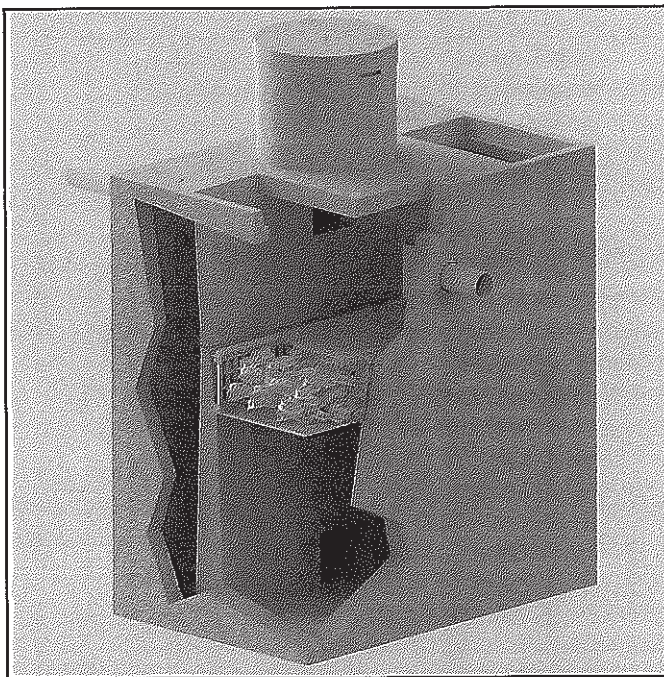



HYDRO-KINETIC® FILTER

Significant reduction of organic matter shall occur in the treatment system prior to the Hydro-Kinetic filter. This Bio-Film reactor shall provide final treatment of the effluent to a near pristine state. Flow equalized liquid from the clarifier shall enter the influent chamber, travel down and be evenly distributed beneath the filtration media. The effects of gravity shall cause solids to settle to the bottom of the tank. As liquid travels up through the proprietary attached growth media, further reduction of organic matter shall take place. Additional settling and consolidation of solids shall take place downstream of the filter media. After passing through the filtration media for final polishing, the highly treated liquid shall flow into the final effluent zone before exiting the Hydro-Kinetic filter through the outlet tee.

MODEL 600 FEU

SERVICE PRO® MODEL 801P ELECTRICAL CONTROL CENTER

The Model 801P control center with MCD technology shall provide Monitoring, Compliance and Diagnostic functions for the treatment system. The pre-wired controls shall be mounted in a lockable NEMA rated enclosure designed specifically for outdoor use. The control center shall be a UL Listed assembly and shall include a time clock, alarm light, reset button, power switch, power light, phone/network light, recirculation pump light, air pump light, high water light and auxiliary alarm light. A pre-programmed time clock shall control the recirculation pump to insure that approximately 400% of the average daily flow is returned to the anoxic chamber. The control center shall monitor recirculation pump current, air pump operation, high water and auxiliary alarm circuitry. In the event of an alarm from the air pump or auxiliary input, the audible and visual alarms shall activate and the optional telemetry system shall report the condition. If abnormal operation of the recirculation pump is detected, a diagnostic sequence shall begin and the visual alarm shall activate. After a factory programmed recovery interval, an automatic restart attempt shall be initiated. If normal pump operation does not resume during 24 programmed recovery and restart cycles, the audible alarm shall activate and the optional telemetry system shall report the condition to the Service Pro monitoring center.

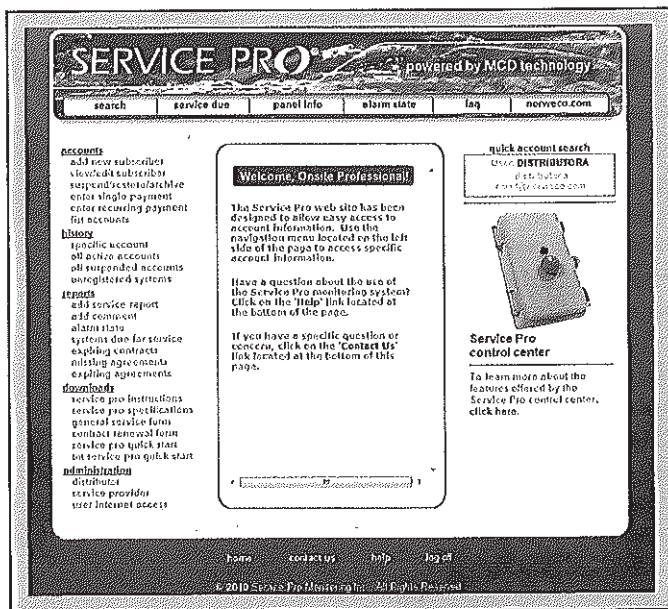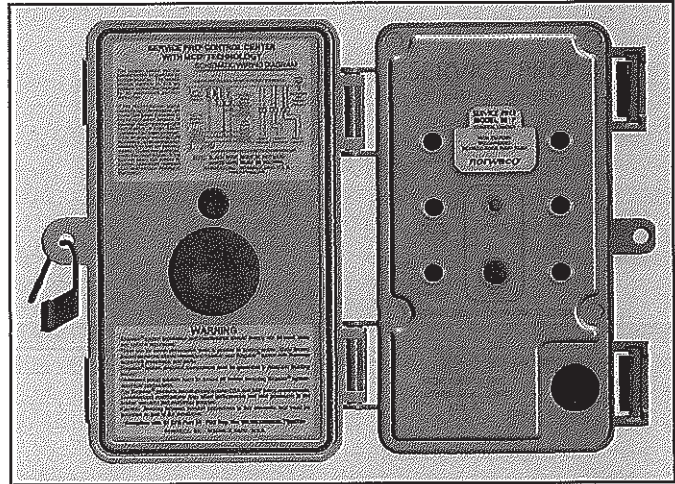

SERVICE PRO® MONITORING CENTER

The Service Pro monitoring center shall include a 128 bit encrypted password protected website for interface with the monitoring center database. Access to the secure website shall be obtained through a unique user name and password that provides tiered access to data from monitored treatment systems. Access level tiers shall include distributors, service providers, regulatory agencies and individual system owners. Distributors and service providers shall be able to create accounts, enter serial numbers for system equipment, maintain service records and grant regulatory agencies access to the information. The monitoring center shall have the capability to schedule future service inspections and provide notification. Individual system owners shall be able to view information regarding their own systems, as well as download instructional information. Integrity of stored data shall be maintained through the use of multiple servers operating in geographically isolated locations.

MODEL AT 1500 ULTRAVIOLET DISINFECTION SYSTEM (Optional)

The Hydro-Kinetic system shall be furnished complete with a Model AT 1500 ultraviolet disinfection system. The AT 1500 system shall incorporate a turbulence inducer and dual-pass design to insure pathogenic organisms receive maximum exposure to the ultraviolet light source. Effluent fecal coliform concentrations shall be consistently reduced to less than 200 mg/L. The ultraviolet disinfection system shall be UL Listed under Standard 979 as a residential treatment device and shall include a disinfection chamber, turbulence inducer, extension riser, quartz tube, Teflon cover, ultraviolet bulb and controls. An interlock switch shall be furnished to automatically disable the ultraviolet light source when the disinfection chamber is accessed. Ultraviolet disinfection systems without a residential UL Listing and an interlock switch have not demonstrated compliance with international electrical standards for safety and reliability and shall not be considered for this application.